
CLASSIFICATION OF REACTION TO FIRE ACCORDANCE WITH EN 13501-1:2018

1. Introduction

This classification report defines the classification assigned to 12,5 mm Kronocompact CGS board in accordance with the procedures in EN 13501-1:2018.

Sponsor: Kronospan HPL Sp. z o.o.
Wojska Polskiego 3
39-300 Mielec, Poland

Prepared by: SYCHTA LABORATORIUM Sp. J.
Laboratorium Badań Palności Materiałów
ul. Ofiar Stutthofu 90
72-010 Police, Poland

Notified Body No: -

Product name: 12,5mm Kronocompact CGS board

Classification report No: SL/Z-313/EN13501/0325a/2022

Date of issue: 25.05.2022

This classification report consists of four pages and may only be used or reproduced in its entirety.

2. Details of classified product**2.1. General**

The product, 12,5 mm Kronocompact CGS board

2.2. Product description

The product, 12,5mm Kronocompact CGS board, is described below or is described in the reports provided in support of classification listed in 3.1

CGS wall panel, covered by white laminate on the both sides, total thickness of 13,1-13,3 mm and weight per unit area 17,8 kg/m².

3. Reports and results in support of this classification

3.1. Specific conditions

-

3.2. Reports

Name of Laboratory	Name of sponsor	Report ref. No.	Test method and date Field of application rules and date
Sychta Laboratorium	Kronospan HPL Sp. z o.o.	SL/Z-313/PN13823/0324a/2022	PN-EN ISO 13823 PN-EN ISO 11925-2 18.05.2022

3.3. Results

Test method and test number	Parameter	No. Tests ^a	Results	
			Continuous parameter - mean (m)	Compliance with parameters
PN-EN 13823	FIGRA, W·s ⁻¹	3	181	(-)
	THR _{600s} , MJ		12,1	(-)
	LFS < edge		(-)	Compliant
	SMOGR, m ² ·s ⁻²		1	(-)
	TSP600s, m ²		5	(-)
	Flaming particles or droplets, time s		(-)	Compliant
PN-EN ISO 11925-2 Exposure time 30 s	Flame spread > 150 mm in 60 s, mm	6	(-)	Compliant
	Ignition of paper		(-)	Compliant

^a Not for extended application, (-): not applicable

4. Classification and field of application

4.1. Reference of classification

This classification has been carried out in accordance with EN 13501-1:2018.

4.2. Classification

The product, 12,5 mm Kronocompact CGS board, in relations to its reaction to fire behaviour is classified:

C

The additional classification in relations to smoke production is:

s1

The additional classification in relations to flaming droplets / particles is:

d0

The format of the reaction to fire classification for construction products excluding floorings and linear pipe thermal insulation products is:

Fire behaviour		Smoke production			Flaming droplets	
C	-	s	1	,	d	0

Reaction to fire classification: C-s1,d0

4.3. Field of application

This classification is valid for the following product parameters:

- CGS wall panel, covered by white laminate on the both sides
- total thickness of 13,1-13,3 mm
- weight per unit area 17,8 kg/m²

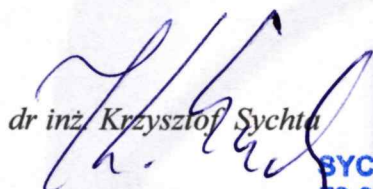
The classification is valid for the following end use applications:

The material mechanically fixed on a structure made of steel profiles to non-combustion substrates of class A1 or A2-s1, d0, with a ventilated or non-ventilated air gap.


5. Limitations

This classification document does not represent type approval or certification of the product.

**Signature of person
undertaking classification:**


dr inż. Krzysztof Sychta

**Signature of person
authorising report:**


dr hab. n.t. Zygmunt Sychta

SYCHTA LABORATORIUM Sp. J.
72-010 Police, ul. Ofiar Stutthofu 90
tel./fax +48 91 4210 214, tel. 502078855
e-mail: biuro@sychta.eu www:sychta.eu
KRS 0000387681 REGON 321023120
NIP 9513152392